
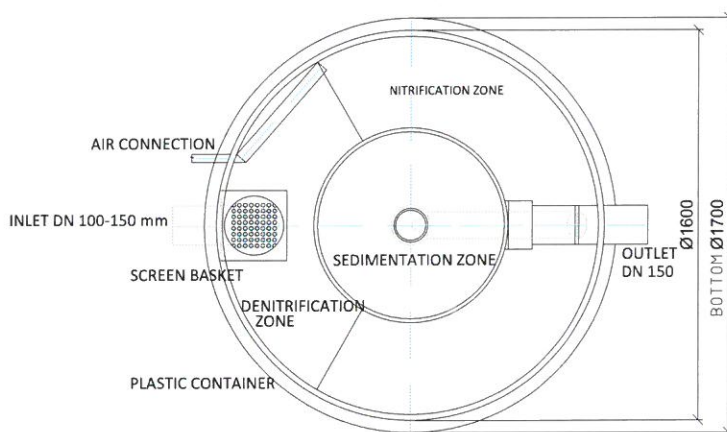


Drawing of waste water treatment plant BioCleaner® BC 6 PP

envi pur
hospodaříme s vodou

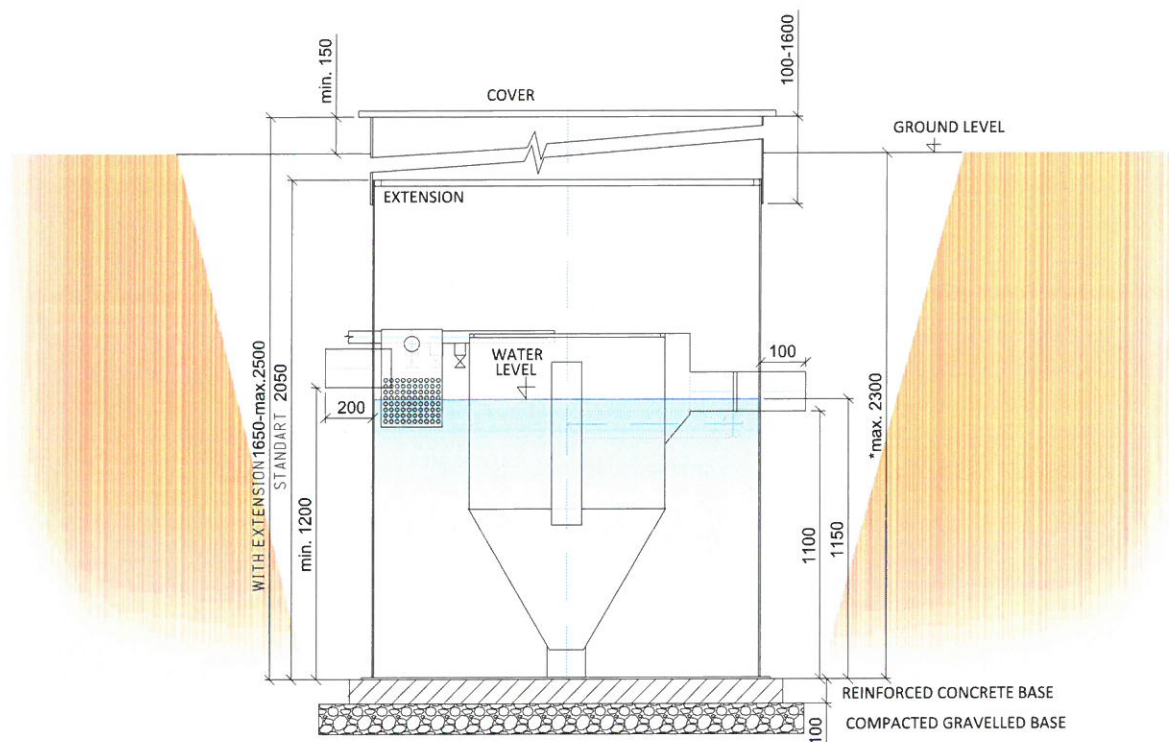

Note: Drawing of WWTP for backfill or concreting. Assembly make according to the Instruction for installation.

* In case the WWTP has to be installed deeper than maximal allowed dimension (see the drawing) or the soil load around the WWTP or underground water level is higher then we strongly recommend statically secure the WWTP tank (e.g. concreting).

Volume of denitrification zone	0.54 m ³	Maximum weight	165 kg
Volume of nitrification zone	1.27 m ³	Installed power	50 W
Volume of sedimentation zone	0.50 m ³	Voltage	230 V
Total volume	2.31 m ³	Protection of supply cable	10 A
Water level	1.15 m	Supply cable (max. 50 m)	CYKY-J 3x2.5



ENVI-PUR, s.r.o.
Na Vlčovce 13/4
CZ - 160 00 Praha 6, Czechia

Head office & production
Wilsonova 420
392 01 Soběslav

+420 381 203 211
info@envi-pur.cz
www.envi-pur.cz

Valid since: January 14th 2022

Prepared by: Josef Vítů