



PLAN VIEW
(with cover removed)

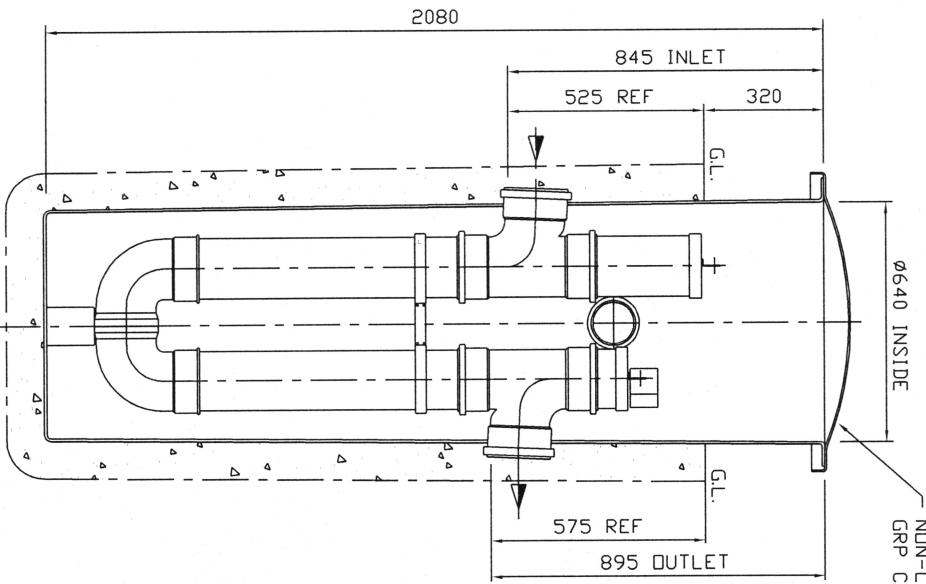

SECTIONAL ELEVATION

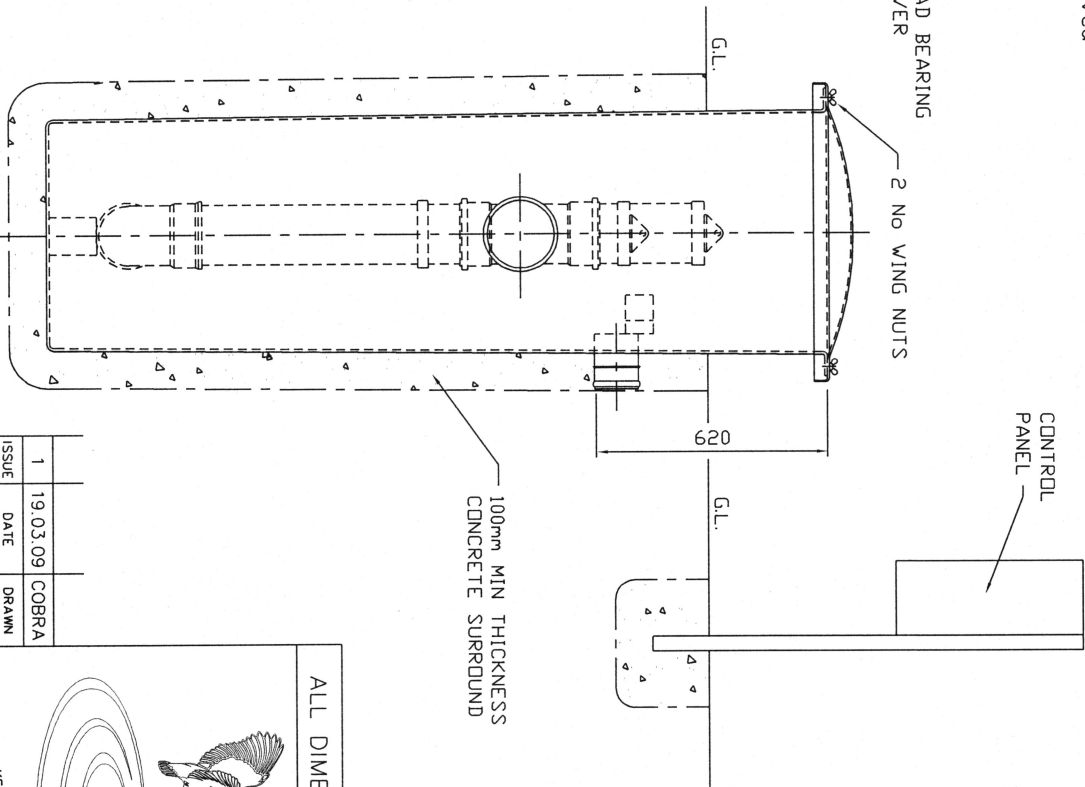

VIEW ON OUTLET

- NOTES:-
1. ELECTRICAL SUPPLY:- 240 VOLTS, SINGLE PHASE, 50 HZ.
 2. REPLACEMENT INTERVALS:-
 - A, LAMPS REPLACE EVERY 12 MONTHS.
 - B, RUBBER WIPERS REPLACE EVERY 12 MONTHS.
 - C, WIRE WIPERS (BRUSH) REPLACE EVERY 24 MONTHS.

INGENJØRFIRMA
TITSON-TITLESTAD A.S.
MASKINER, MILJØ OG ENERGI

Leivvikåsen 39 B, N-5179 Godvik - Bergen
Tlf. +47- 55 29 81 82,
Mobil 920 83158 E-mail : salg@titson-titlestad.no

This drawing is copyright and may not be reproduced or used without the written permission of Kee Process Limited.

KEE PROCESS RESERVE THE RIGHT TO CHANGE SPECIFICATIONS WITHOUT NOTICE

ISSUE	DATE	DRAWN
1	19.03.09	COBRA

THIRD ANGLE PROJECTION

ALL DIMENSIONS ARE IN MILLIMETRES - DO NOT SCALE

KEE PROCESS LIMITED
COLLEGE ROAD, ASTON CLINTON, AYLESBURY
BUCKS. HP22 5EZ Tel: (01296) 634500

TITLE
600 DIA EFF2 & 4
'UV' SYSTEM

SCALE	1:10	D.O. REF.	A2
DRAWING No.	883104	ISSUE	1