


Vedlegg E-1

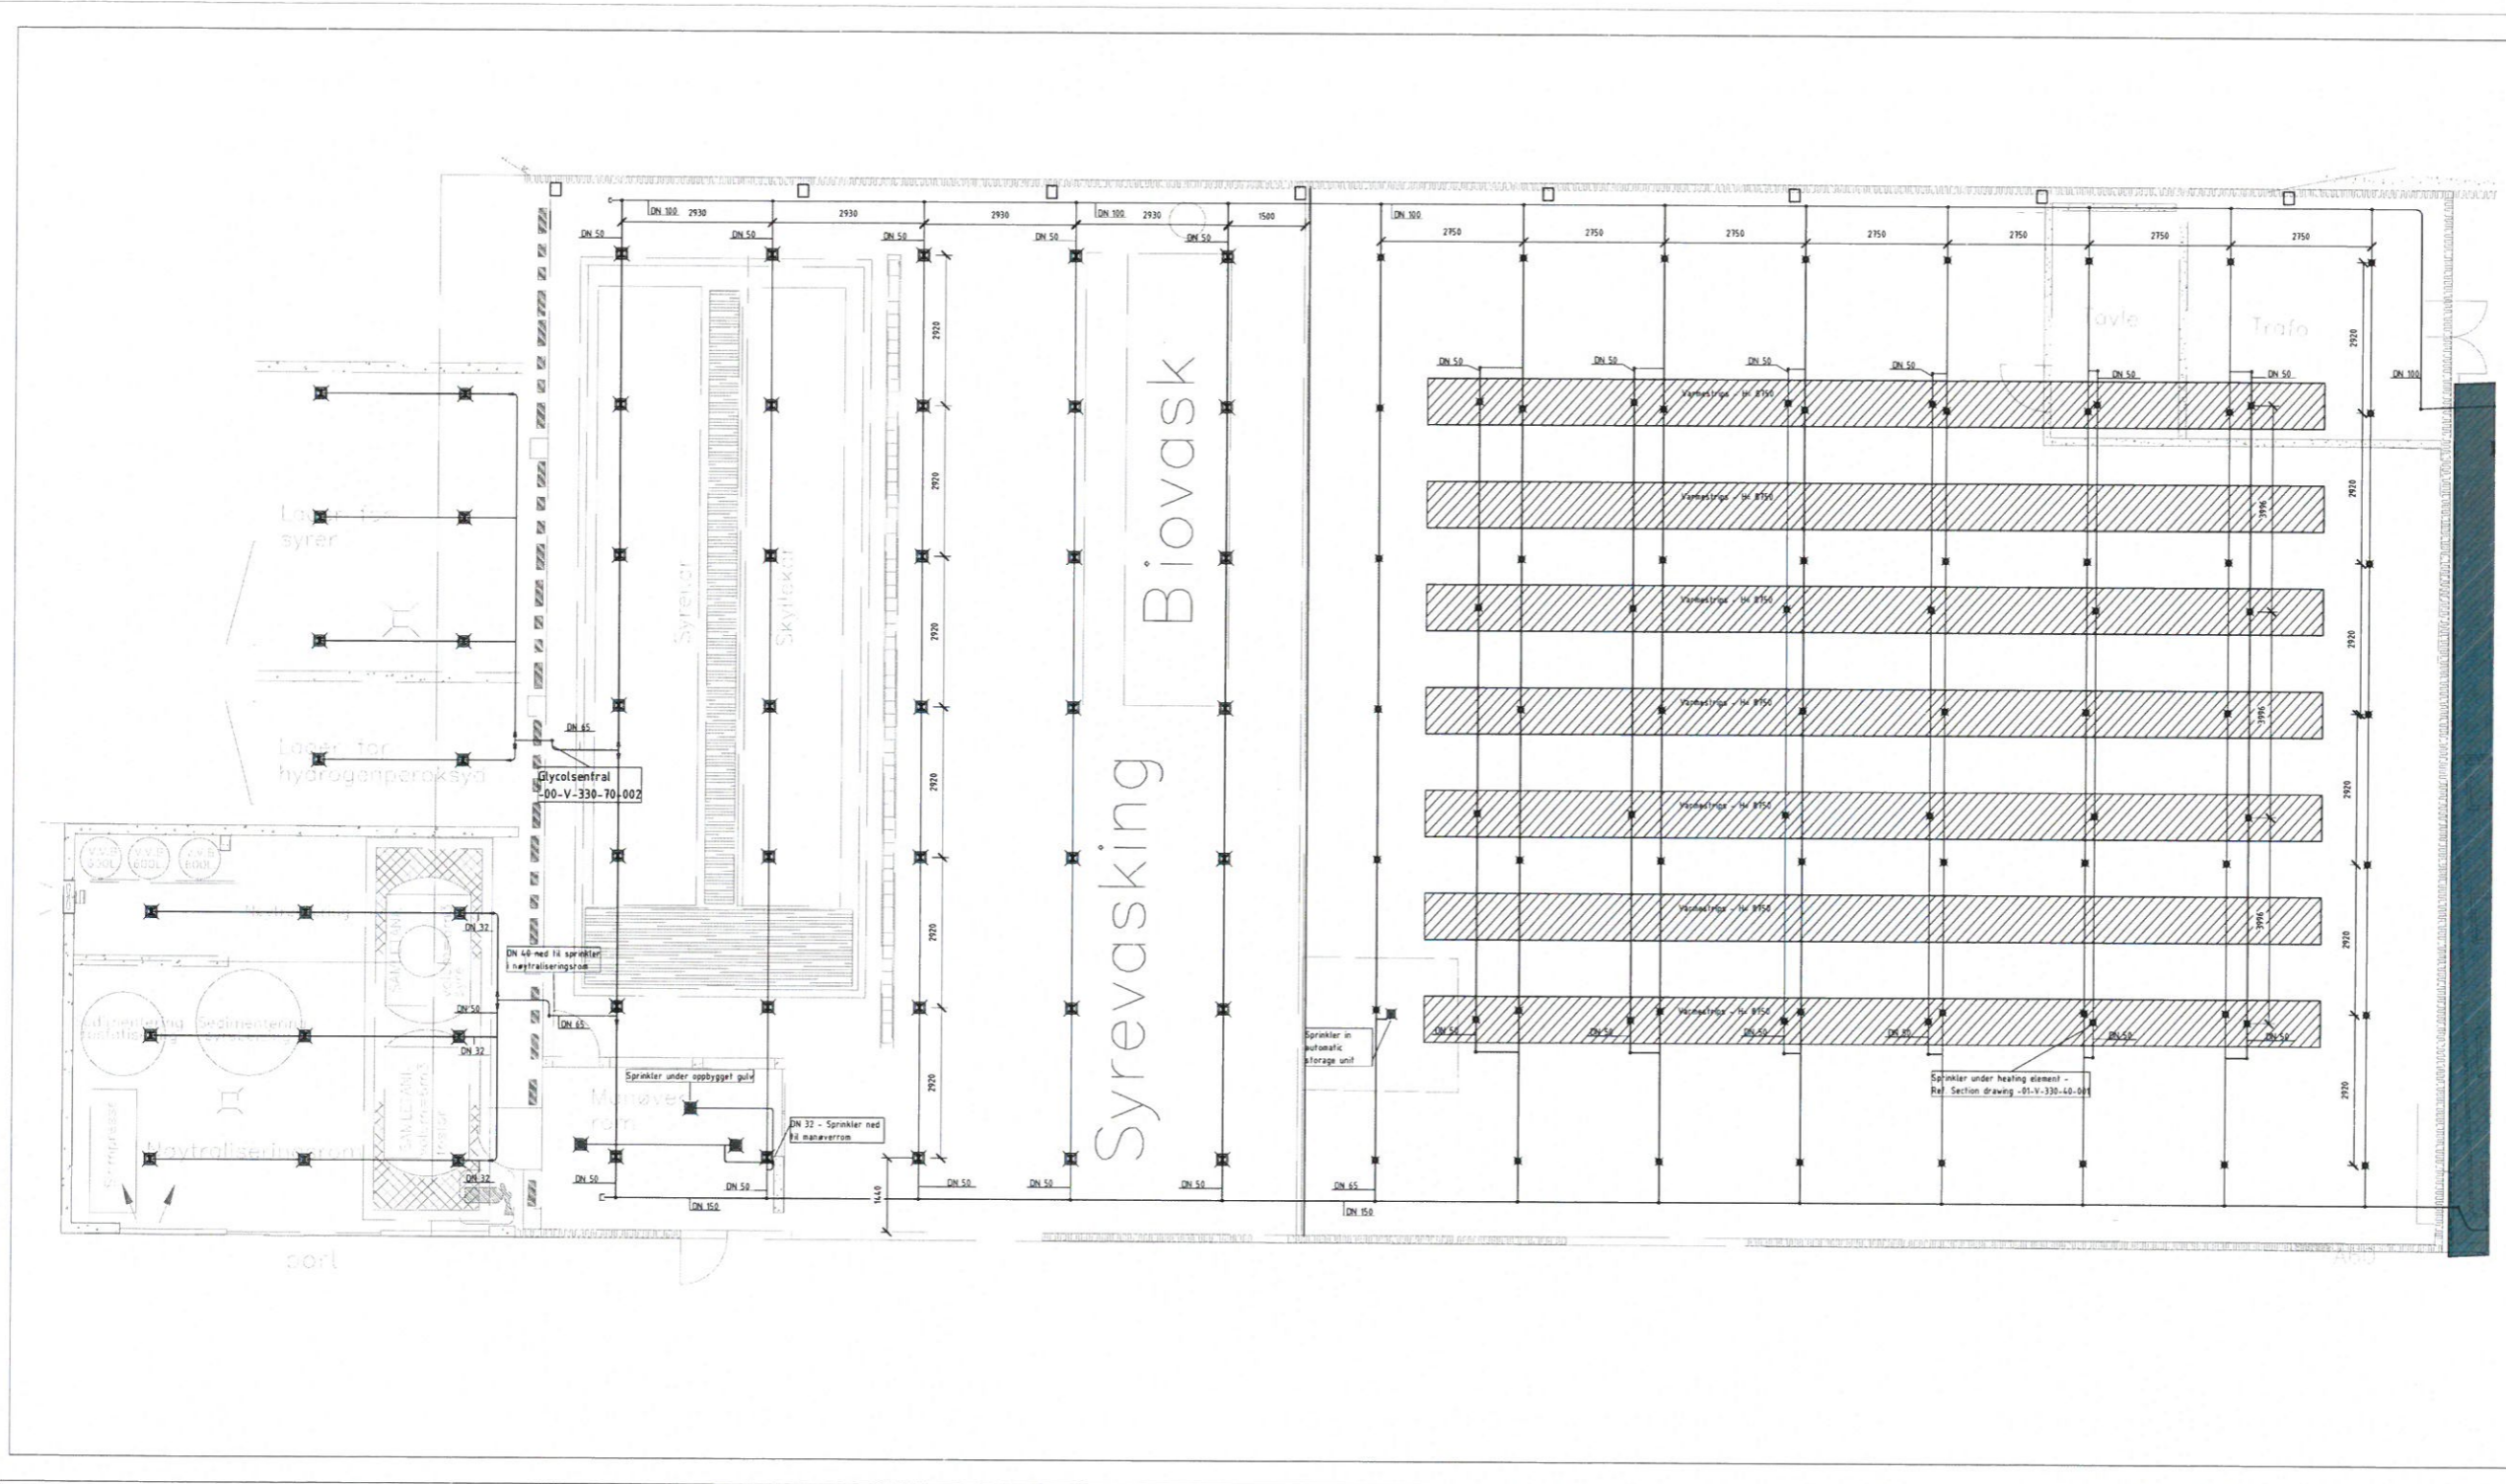




33 Sprinkler - Antall Hall 1 a/b					
ETASJE	SYM	SPRINKLERTYPE	DN	SIN-Nr. (eller Likeverdig)	ANTALL
Plan 1	■	SSP-K80-68°C-SR	75	TY-323	3
Plan 1	■				1
Plan 1	■	ELD-Pendent-K-M1121-68°C-SR	20	TY-5251	52
Plan 1	■				80
Grand total: 136					

Task nr:	10207160	Prosjekt:	-00-V-330-20-001	Rev:	1
----------	----------	-----------	------------------	------	---

1. Prosjekt		2. Dato		3. Rev	
FMFL		RIV	A1LL		
Hall 1-4 Sprinkleranlegg				19.10.2018	
Sprinklersystem				1:50	
Hall 1 a/b					
Multiconsult		Prelimærte		RevSI	
www.multiconsult.no		10207160		-00-V-330-20-001	
				1	

Vedlegg E 2.1

Prosjekt	SYN	SPRINKLERLEGG	20	20	20	20	20	20	20
Plan	1	1	1	1	1	1	1	1	1
Blad nr.	101	102	103	104	105	106	107	108	109


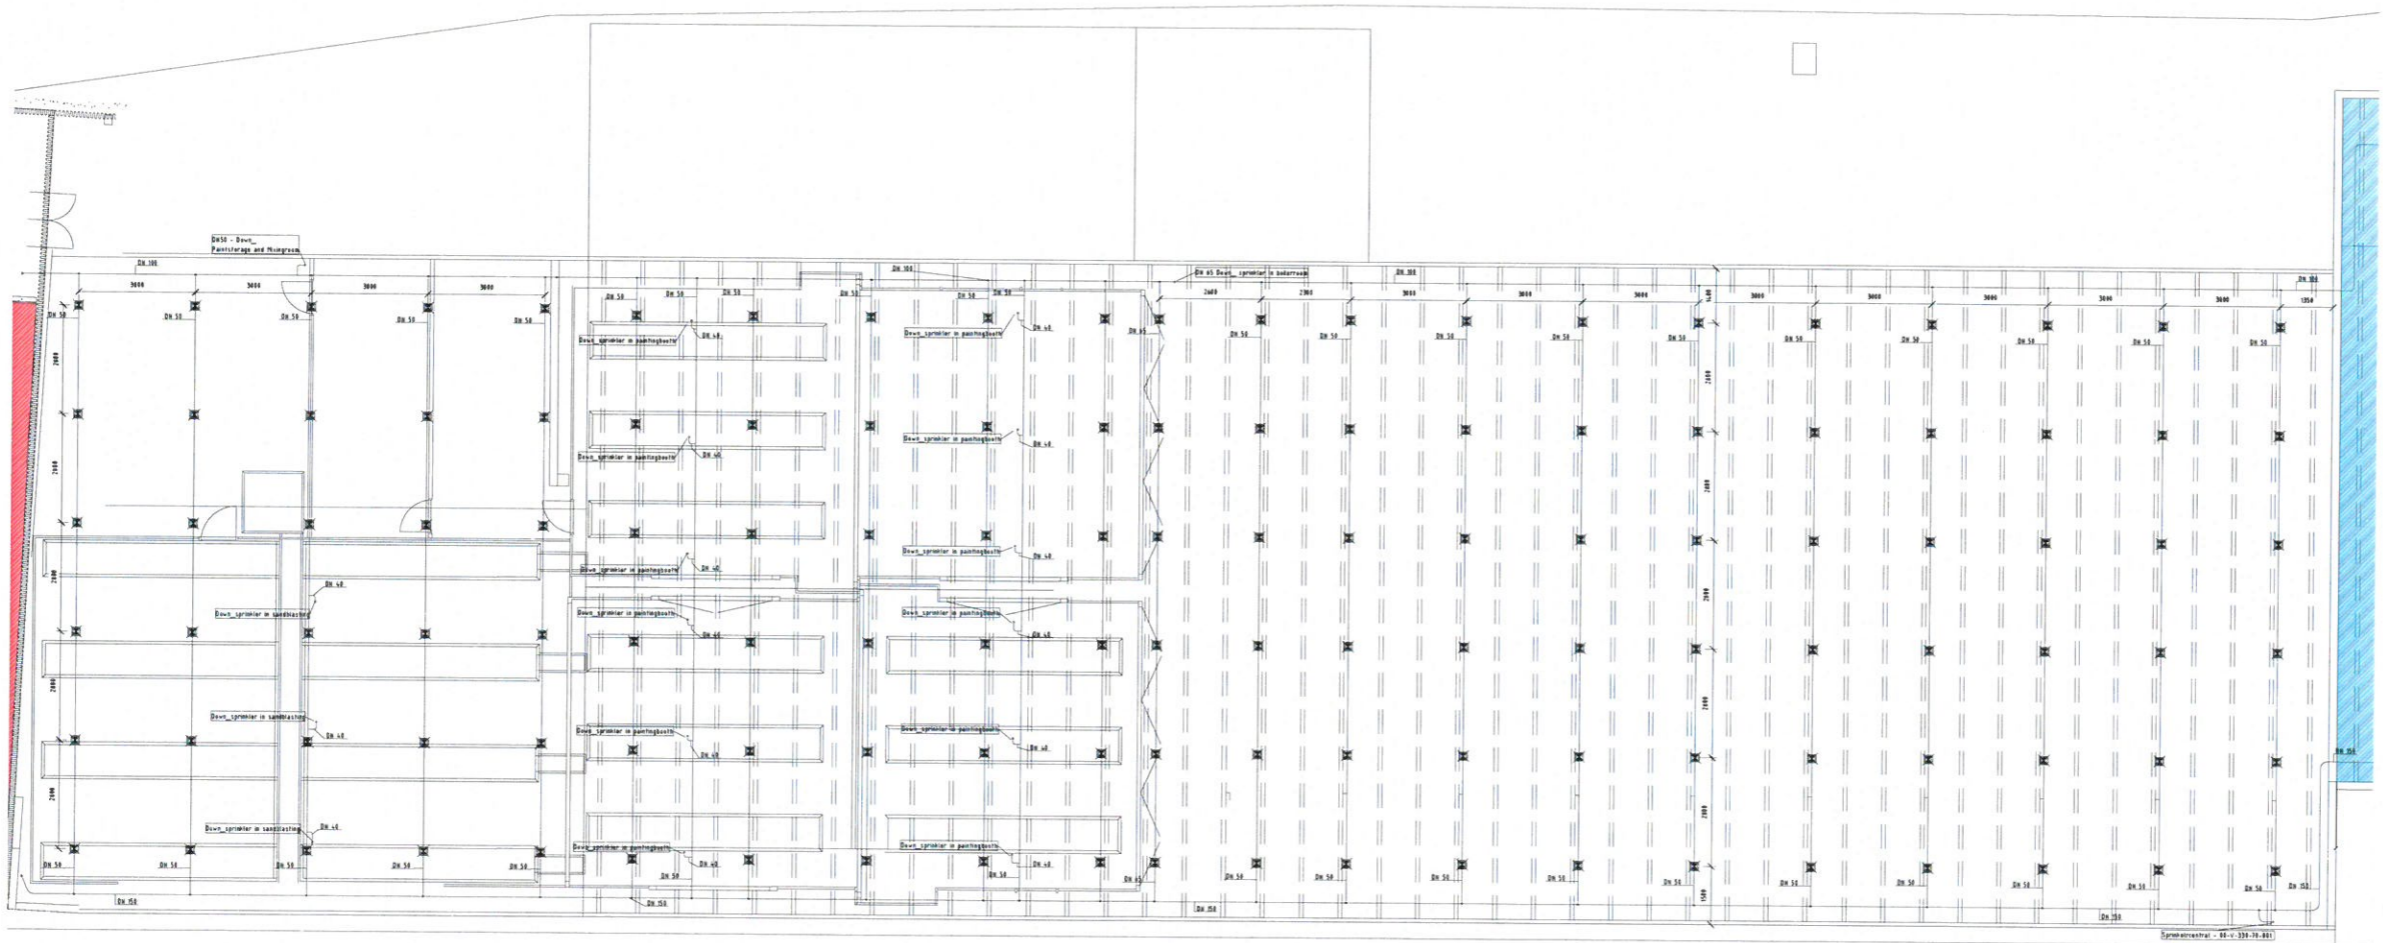


10207160 -00-V-330-20-002 1

Prosjekt	FMFL	Hall 1-4 Sprinkleranlegg	RIV ADL
Oppdragsnr.	10207160	Sprinklersystem	19.10.2018
Bladnr.	10207160	Hall 2	1 : 50
Rev.	1	10207160	1

C:\Users\jlf\Documents\10207160\_1-4\_Sprinkler\_Anlegg\10207160\_V-330-20-002\_01.dwg

SP Sprinkler - total for 2 under messalin					
nr	SYM	SPRINKLER	DR	DR. nr	DR. størrelse
Plan 1	■	SSP-400-40°C-18	28	TY-323	1/2"
Plan 1	■	ELP-1000-40°C-18	28	TY-323	1/2"
Plan 1	●	SSP-400-40°C-18	28	TY-323	1/2"
Grand total					


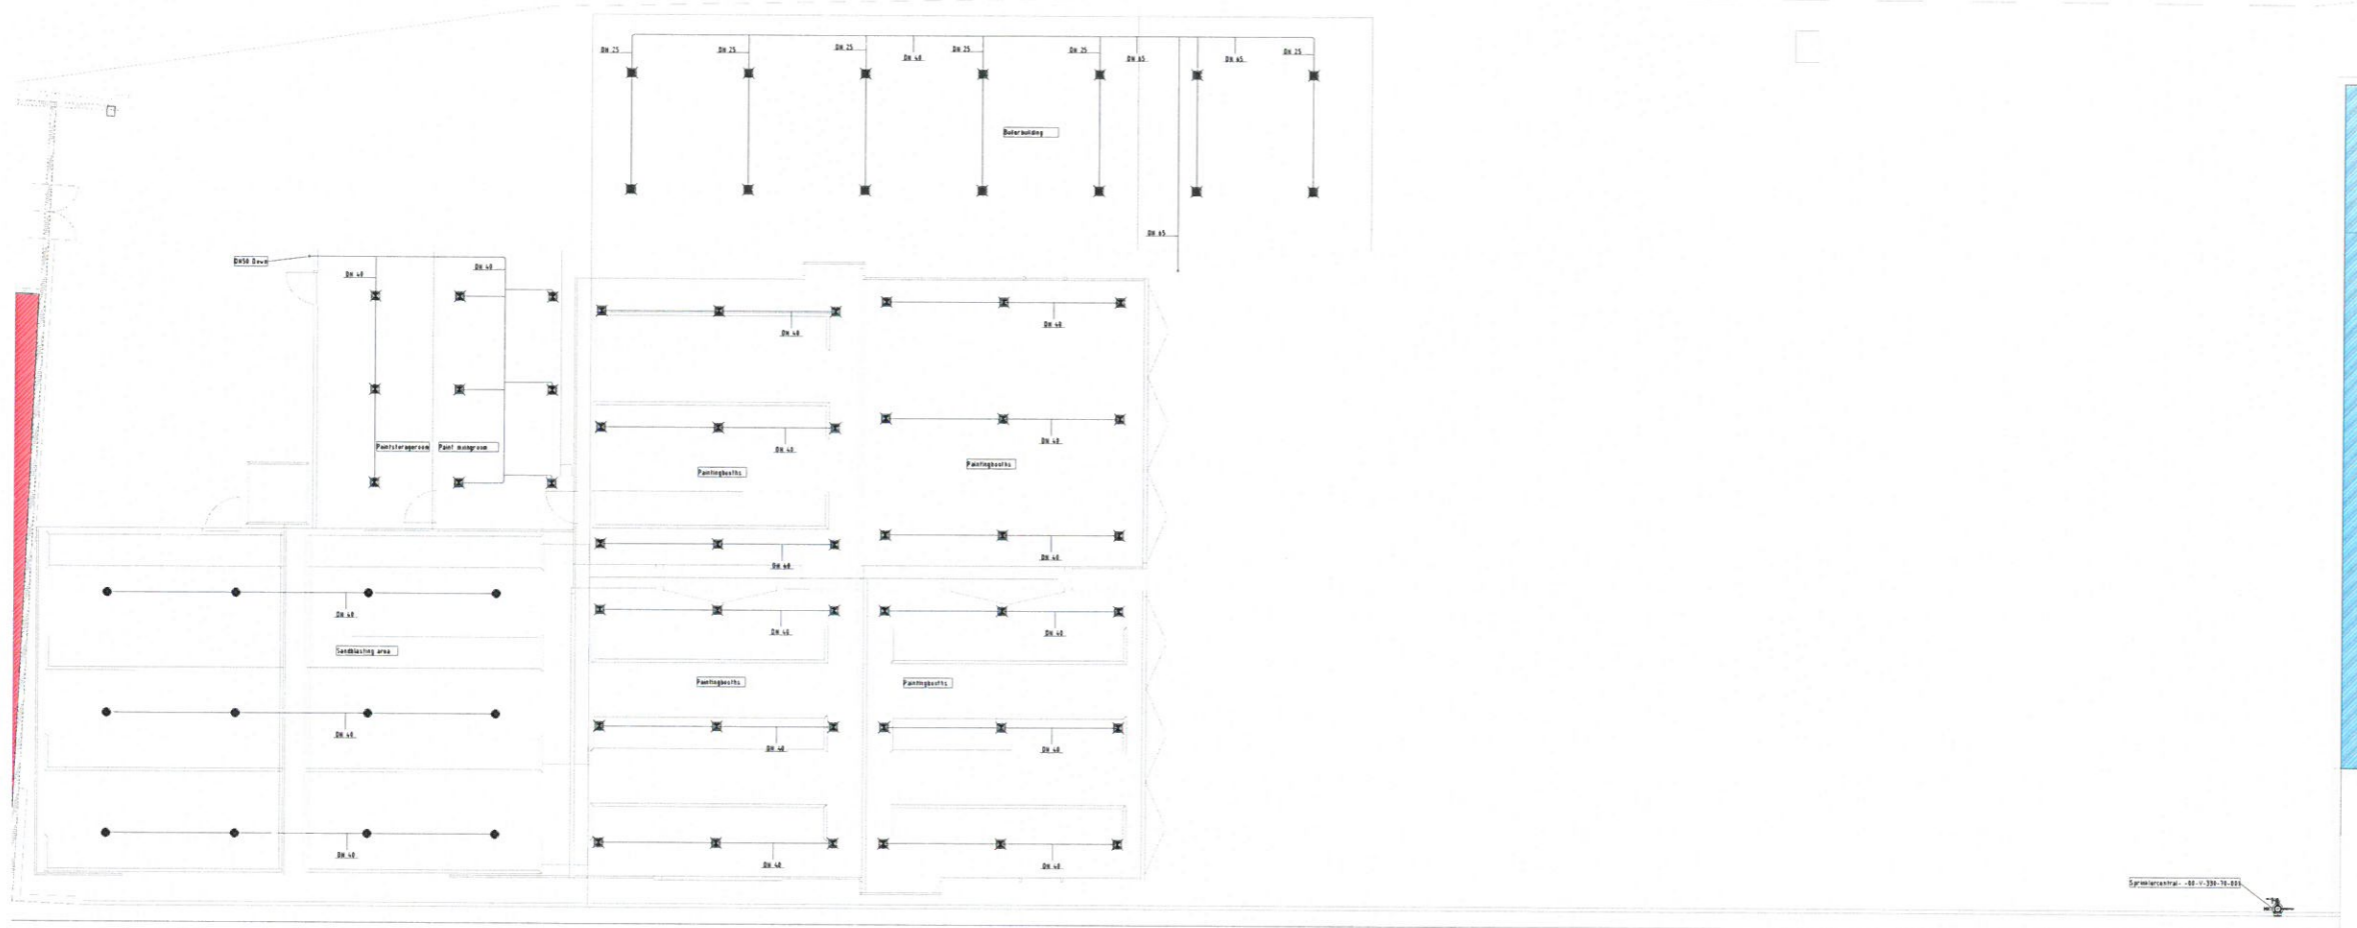


10207160	-00-V-330-20-006	1
----------	------------------	---

FMFL	RIV	AOL
Hall 1-4 Sprinkleranlegg	19.10.2018	
Sprinklersystem		
Hall 2_Under messalin		
Multiconsult	1:50	
www.multiconsult.no	10207160	-00-V-330-20-006

C:\Users\slj\Documents\Hall 1-4\_Sprinkler\_Kontrollrom\_Koff\Multiconsult no\_5196053.rvt

C:\Users\joh\Documents\Hall 1-4\_Sprinkler\_Kaifilament\multiconsult.no\_9796251.rvt

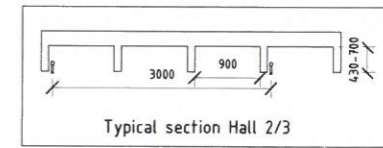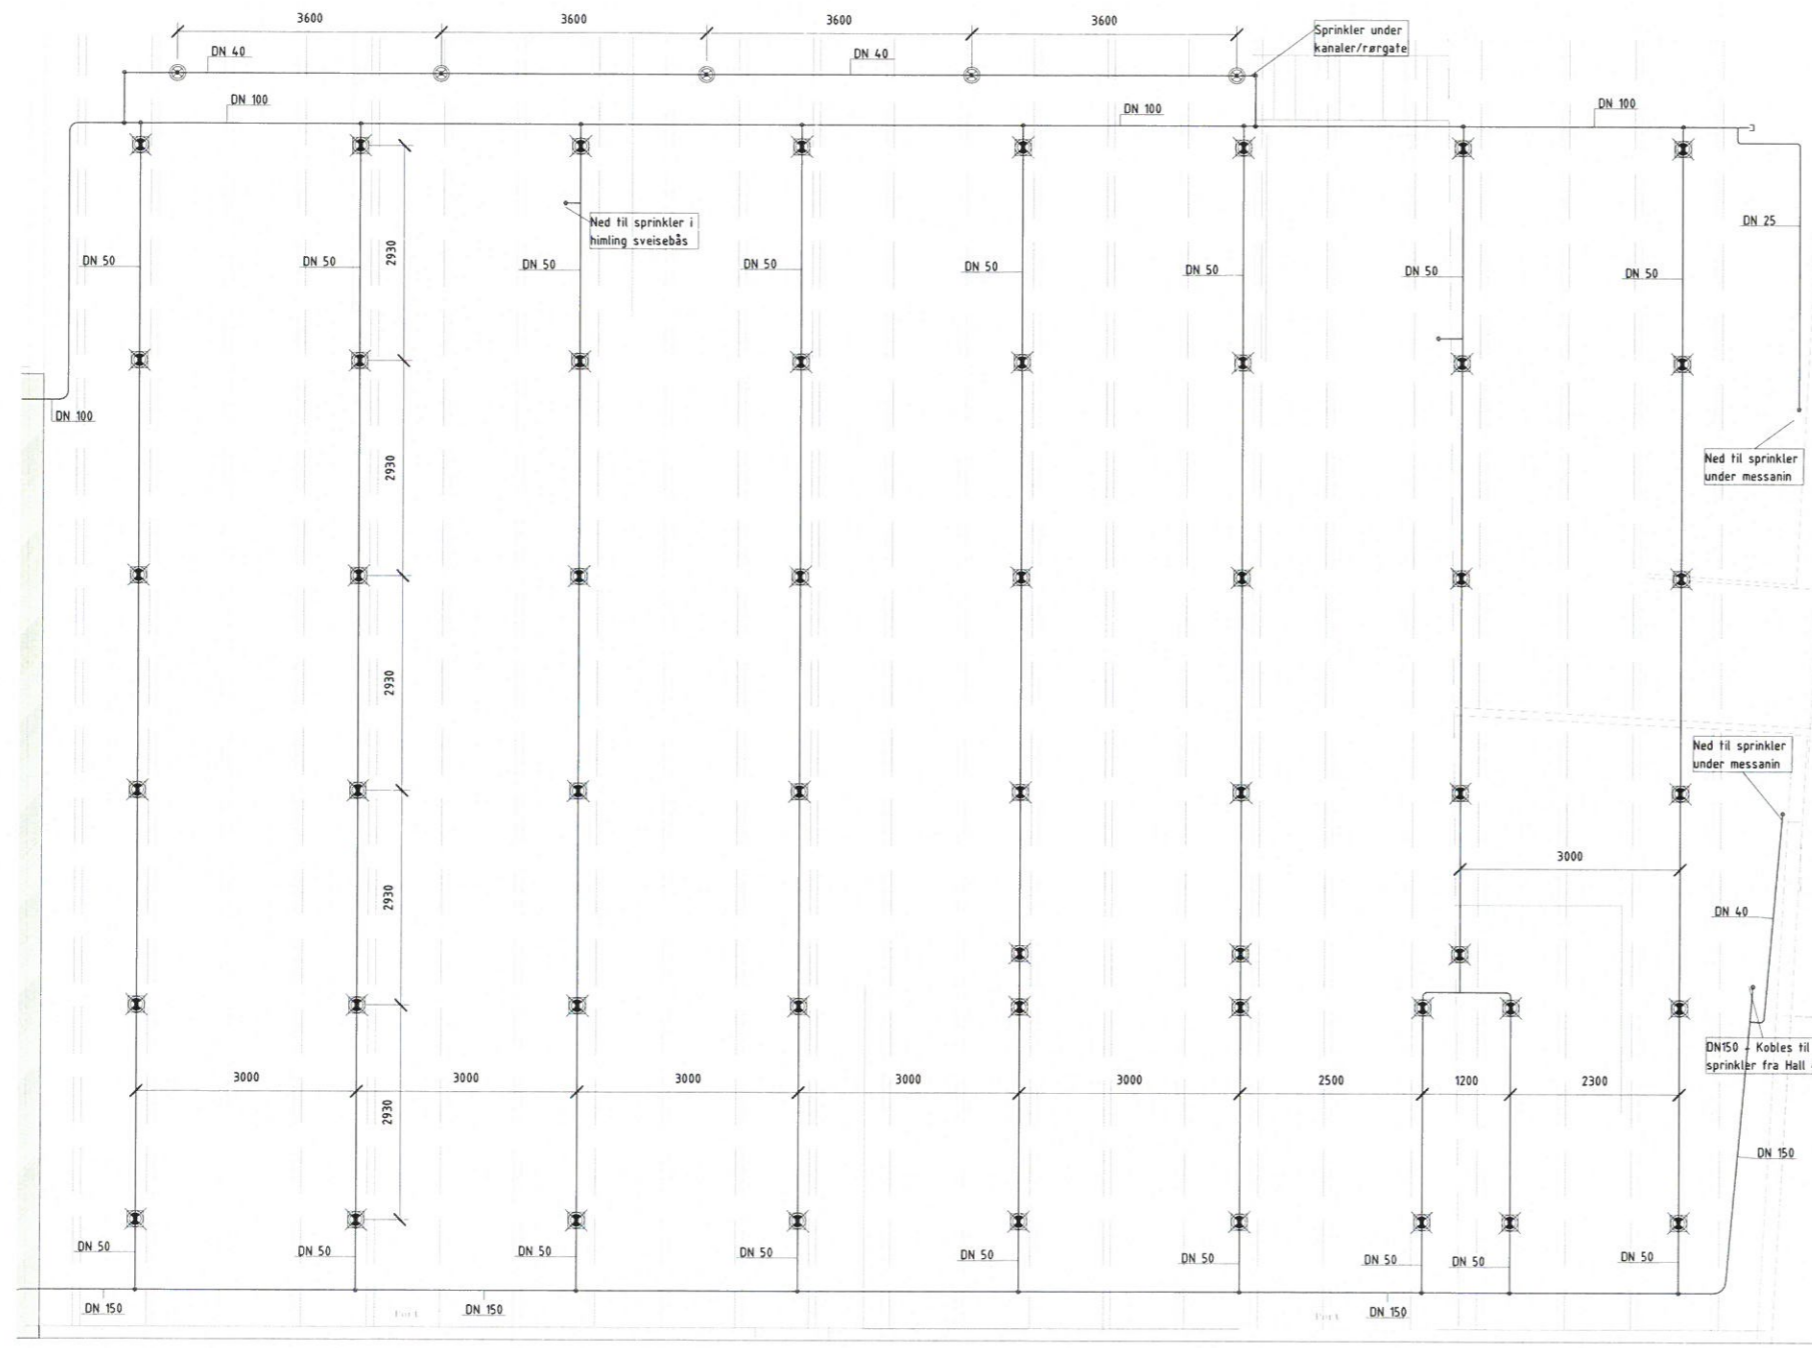

33 Sprinkler - Antall Hall 3					
ETASJE	SYM	SPRINKLERTYPE	DN	SIN-Nr. (Eller Likeverdig)	ANTALL
Plan 1	⊗	SSP-K80-68°C-SR	15	TY-323	5
Plan 1	⊗	ELO-Pendent-K-16(11.2)-68°C-SR	20	TY-5251	53
Grand total: 58					


Vedlegg 3.1

Oppdragsnr.	10207160	Tegningsnr.	-00-V-330-20-003	Rev.	1
-------------	----------	-------------	------------------	------	---

Rev.	1	Tilbudstegning	30.10.2018	KJAF	RonS	MELTI
Rev.		Beskrivelse	Date	Tegn.	Kontr.	Godk.
		FMFL				RIV A1
		Hall 1-4 Sprinkleranlegg				19.10.2018
		Sprinklersystem				Håkestak
		Hall 3				1 : 50
Status		Prelimerny	Kontr. av	RonS	Godkj. av	OleD
Oppdragsnr.		10207160	Tegningsnr.	-00-V-330-20-003	Rev.	1
Bygg Etasje		Fag	Byggingeniør	Type	Tegn.	Lapser

Multiconsult  
www.multiconsult.no

C:\Users\jv\Documents\Vall 1-4\_Sprinkler\_KjetArvufilten\_kj@multiconsult.no\_9119653.rvt

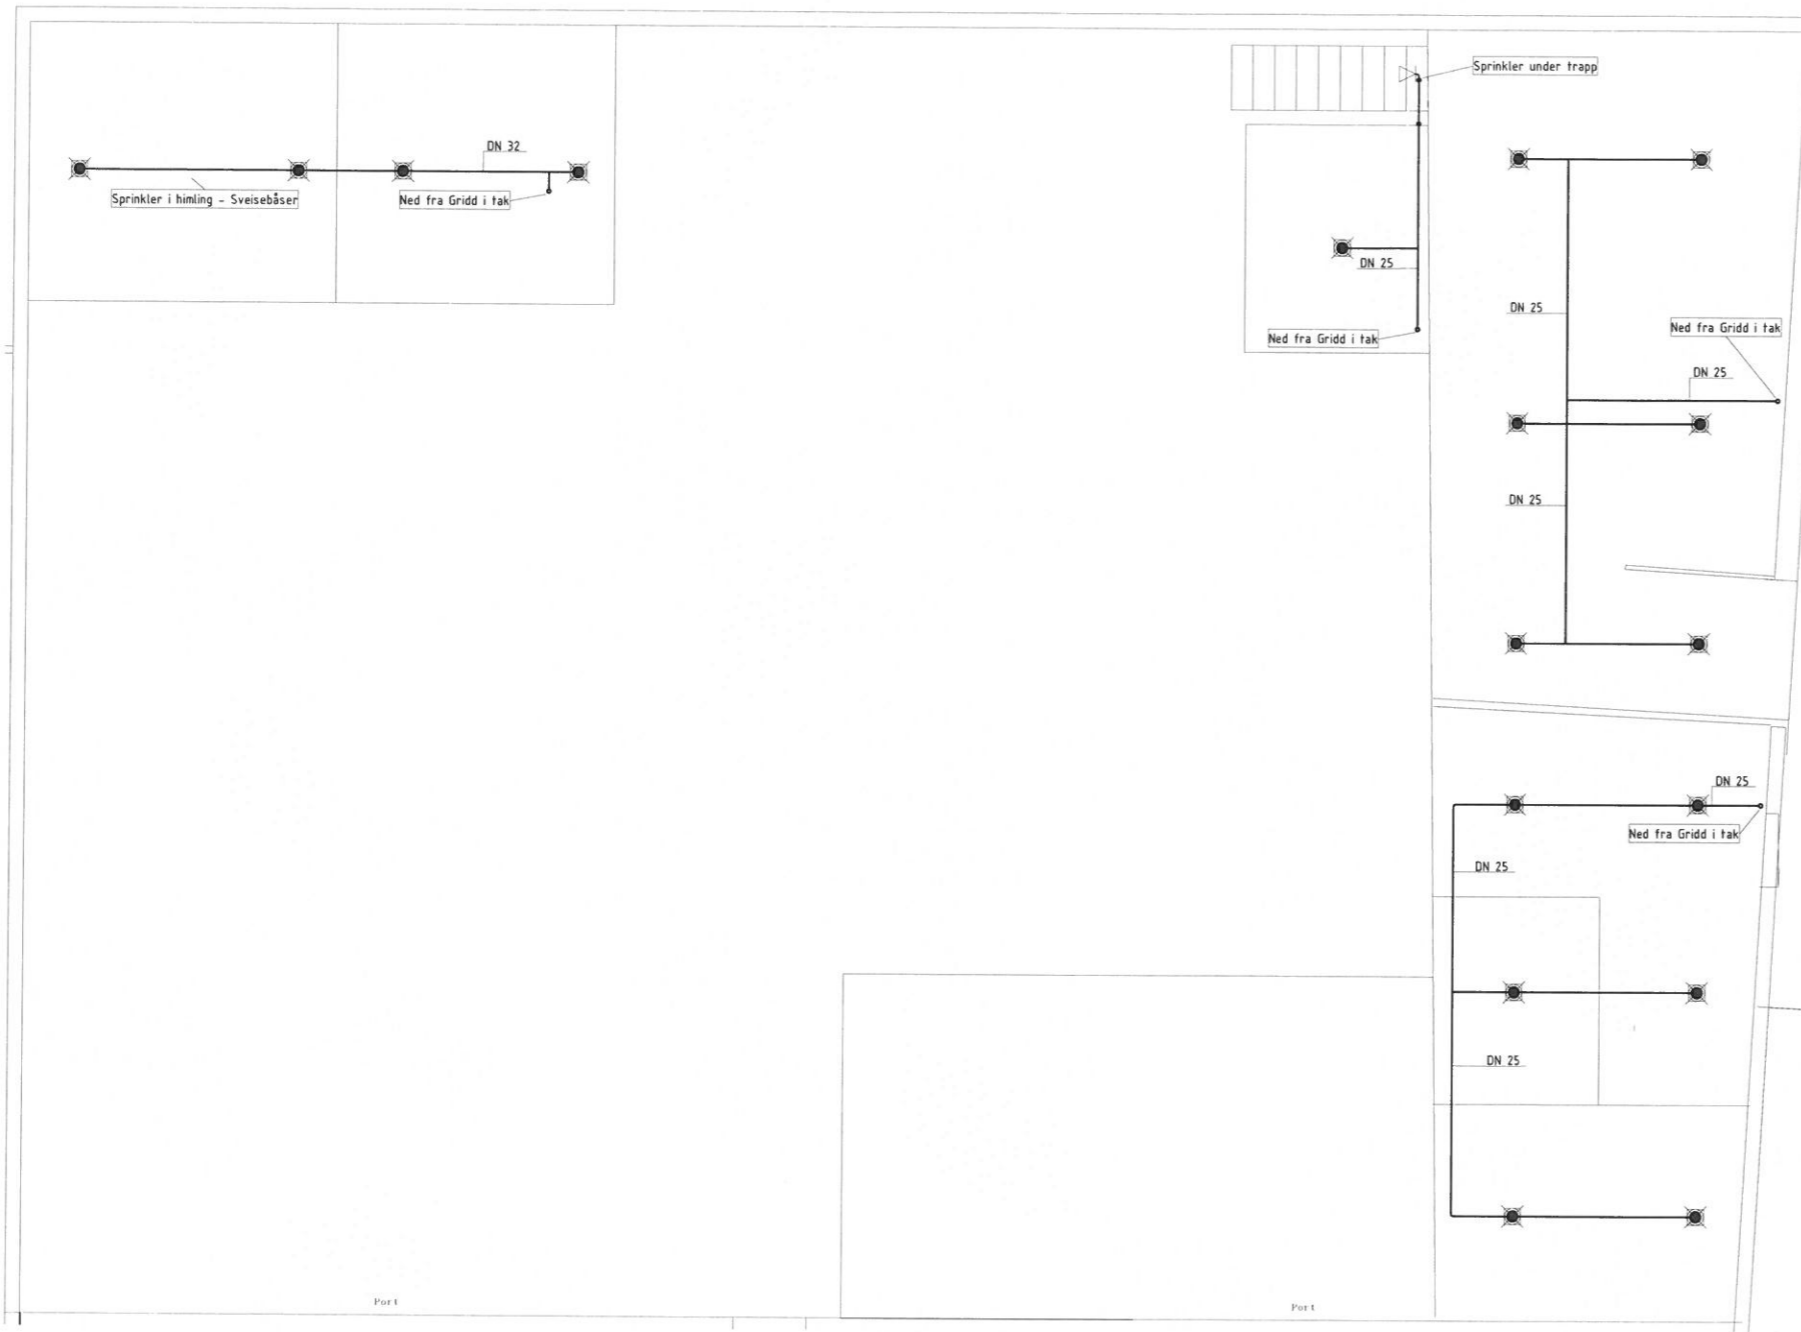

33 Sprinkler - Antall Hall 3_Under Messanin					
ETASJE	SYM	SPRINKLERTYPE	DN	SIN-Nr. (Eller Likeverdig)	ANTALL
Plan 1	■	SSP-K80-68°C-SR	15	TY-323	13
Plan 1	◻	HSW-K-80-68°C-SR	15	TY-3335	1
Grand total:					14

Vedlegg 3.2



Oppdragsnr.	10207160	Tegningsnr.	-00-V-330-20-005	Rev.	1
-------------	----------	-------------	------------------	------	---

Rev.	Tilbuds/tegn.	Beskrivelse	Dato	Kjef	RonS	M&L1
				Tegn.	Kontr.	Godk.
	1	FMFL			RIV	A1
		Hall 1-4 Sprinkleranlegg	19.10.2018			
		Sprinklersystem				
		Hall 3_Under Messanin				
						1 : 50
		Status: Prelimener	Kontr. av: RonS	Godkj. av: OleD		
		Oppdragsnr.: 10207160	Tegningsnr.: -00-V-330-20-005	Rev.: 1		
		Bygg Etasje	Fag	Bygghandlsnr	Type	Tegn. Løper

Multiconsult  
www.multiconsult.no

ETASJE	SYH	SPRINKLERTYPE	DN	SN-Nr (Eller Løsnings)	ANTALL
Plan 1	●	Ultra K-17 -K-2420-N-BI-SR-18°C	25	TY-7953	111
Plan 1	◆	ESPR-25 - K-36025.21 - FR	25	TY-9226	12
Grand total:					123

Vedlegg 4

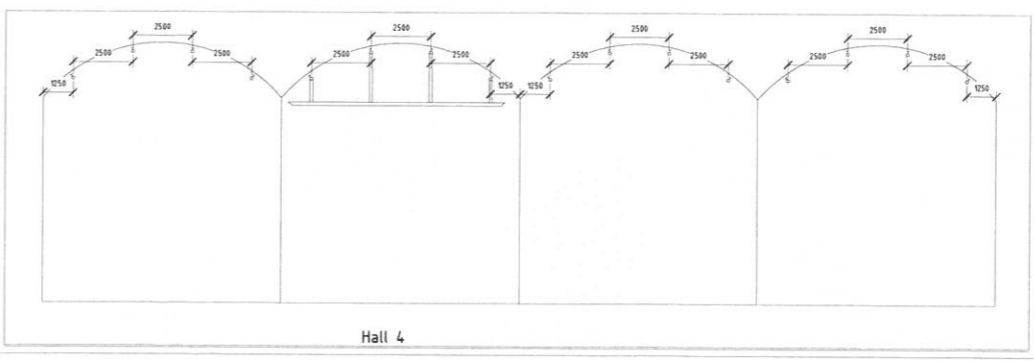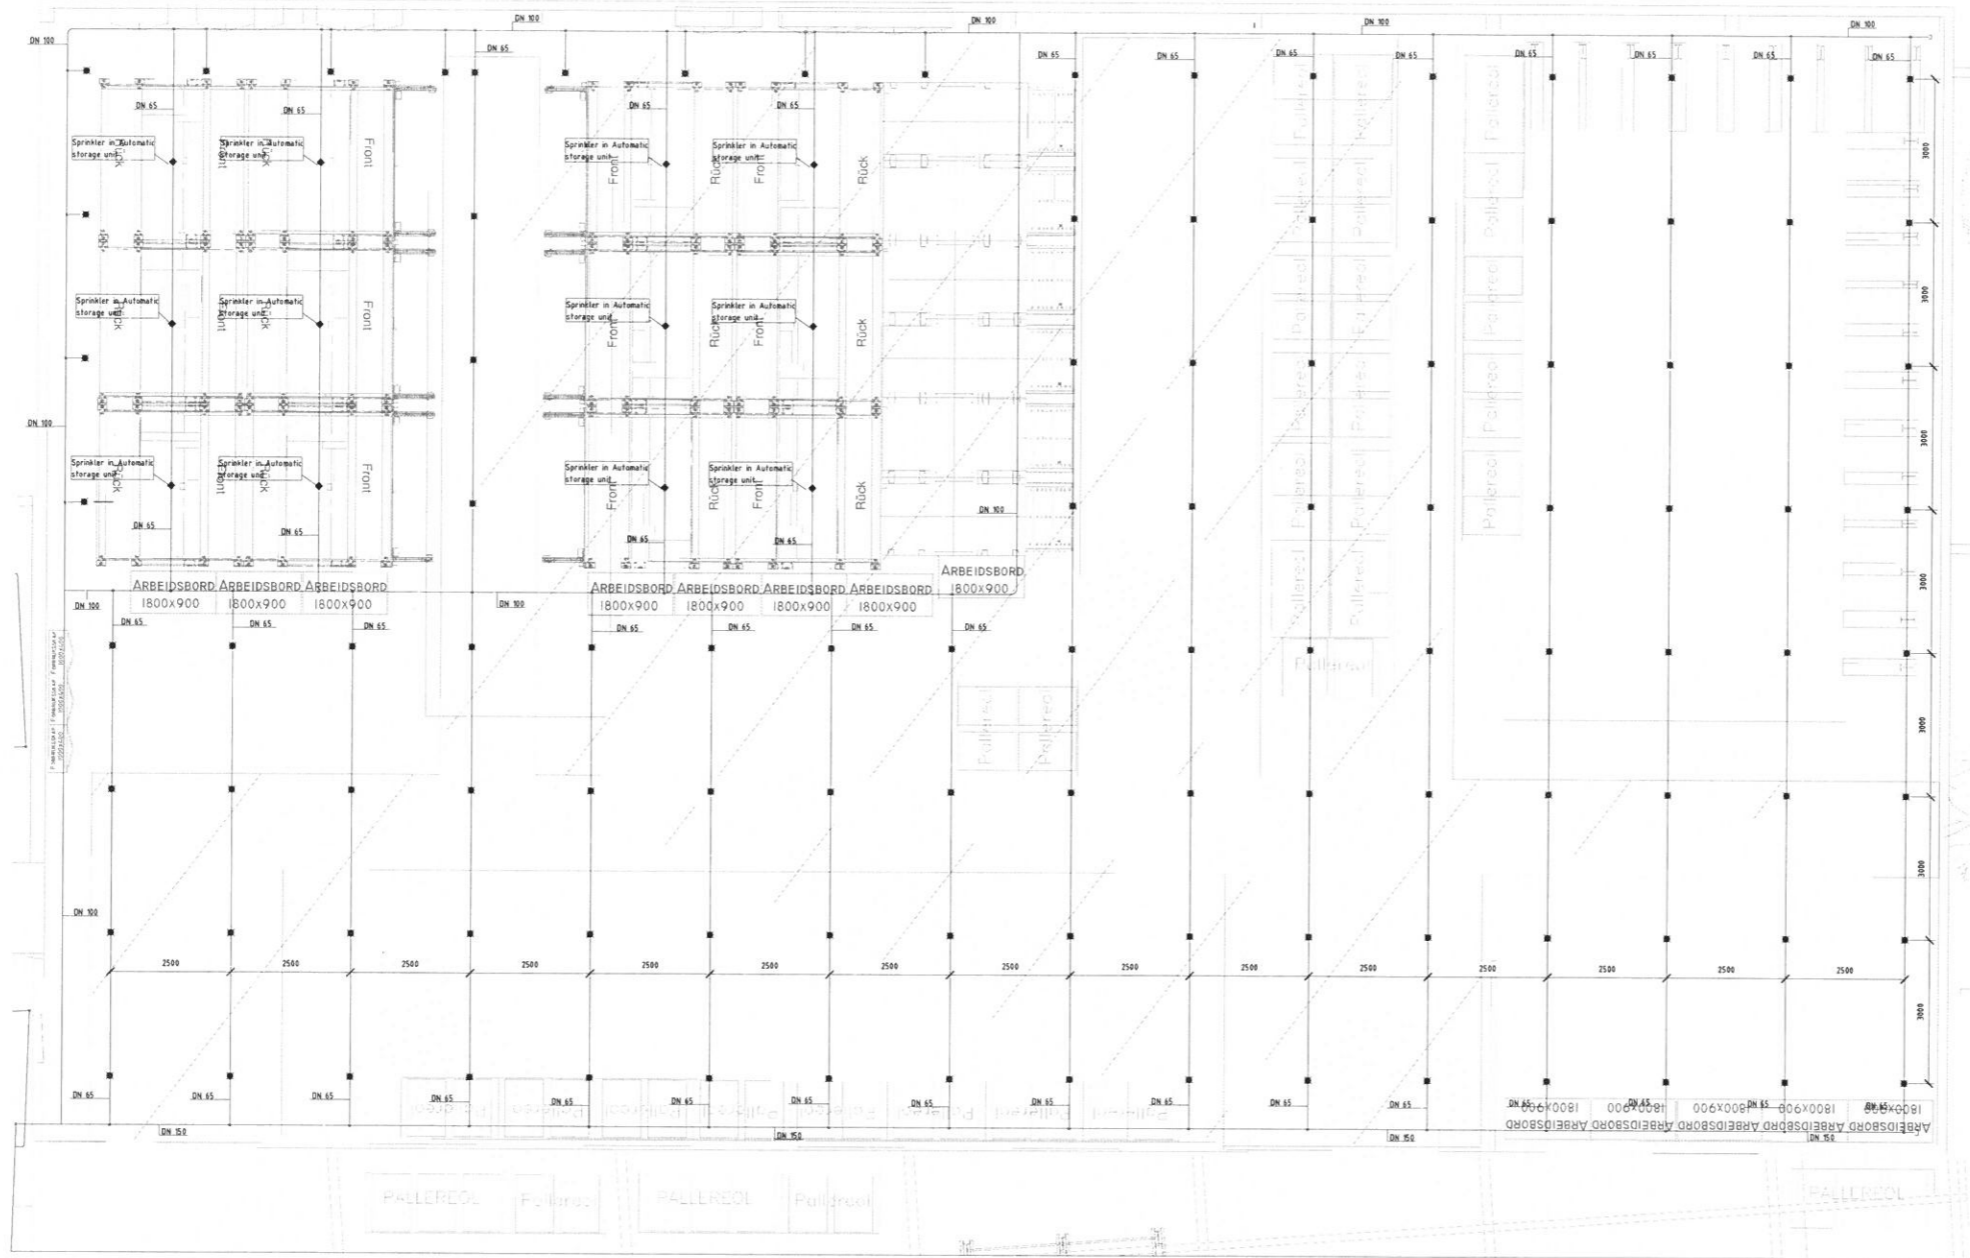

10207160	-00-V-330-20-004	1
----------	------------------	---

FMFL	RIV	A0
Hall 1-4 Sprinkleranlegg		19.10.2018
Sprinklersystem		
Hall 4		1:50
Multiconsult	Preliminary	Ransl
www.multiconsult.no	10207160	-00-V-330-20-004
		1

C:\Users\bjk\Documents\Hall 1-4\_Sprinkler\_KjellAnders\Bren\_Kjell\Multiconsult.no\_211916053.rvt